

東莞永力電業有限公司

YUNG LI CO., LTD

Da Pu Industrial Zone, Gang Zi, Changping Town,
Dong Guan City, Guangdong 523571 China.P.R.C

TEL:0769-83396797~8

FAX:0769-83396796

E-mail: sales@yung-li.com

Description: YP-03/YC-14

Customer: MAG


Parts No. : CB-3-CH

Draw No. :

REVISION RECORD

1		
2		
3		
4		
5		

YUNG LI		CUSTOMER	APPROVED
CHECKED	PREPARED BY		

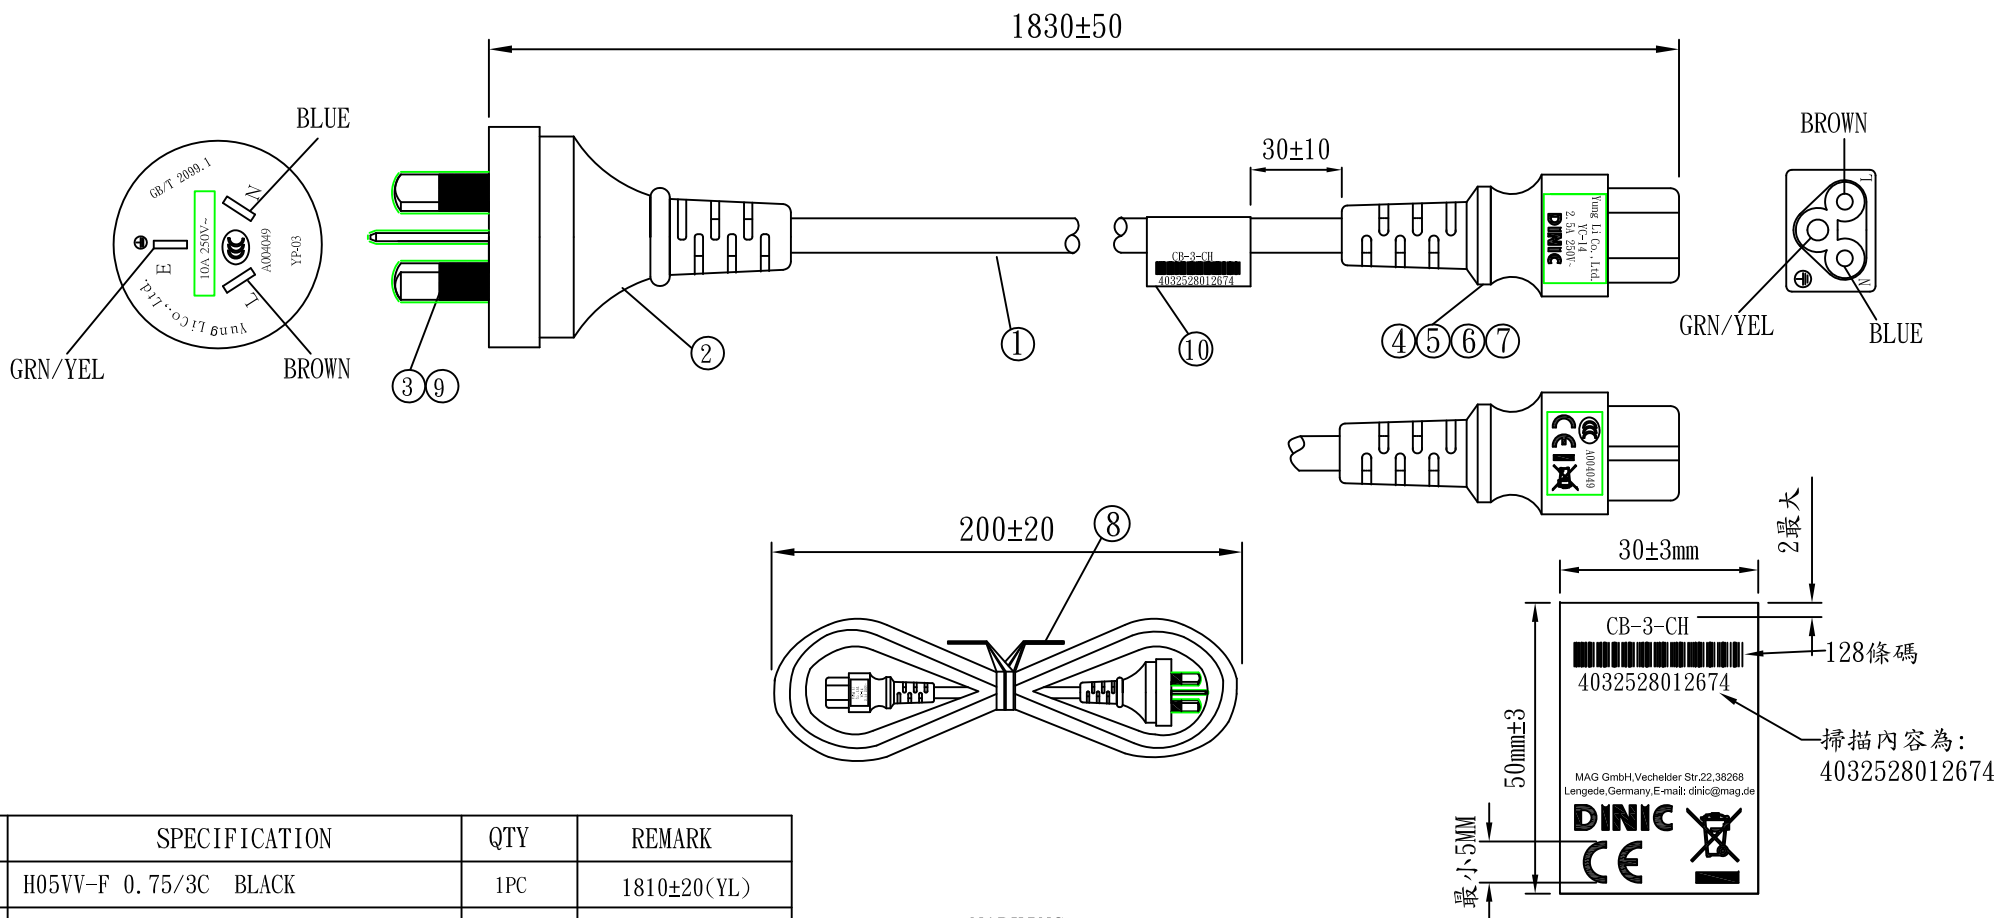

NO.	SPECIFICATION	QTY	REMARK
1	H05VV-F 0.75/3C BLACK	1PC	1810±20(YL)
2	YP-03 PVC PLASTIC:50P BLACK	32g/PC	
3	TER:P87655SJ-3P BLACK	3PCS	
4	YC-14 PVC PLASTIC:50P BLACK	18g/PC	
5	TER:98732PS-0	1PC	
6	TER:98714PS-0	2PCS	
7	H. S. G:YC-14 BLACK	1PC	
8	MINI TIE:L=130mm BLACK	1PC	
9	SLEEVE:3PIN	1PC	
10	LABEL:50*30mm	1PC	

MARKING:



☑ Yung Li Co., Ltd. H05VV-F 3G 0.75mm² <VDE> **CE** SAA-190646-EA

☑ SU01027-4002 **CCC** A004049 60227 IEC 53(RVV) 300/500V





Tolerance >0±0.30 >1.0±0.50 >10.0±1.0 >20.0±2.0 Angle: ±1°	Approved		Date		YUNG LI CO.,LTD				
	Checked		Date						
	Drawn	SUKI	Date	25.08.07	Customer	MAG			
	Cat. No.	YP-03/YC-14				P/N.	CB-3-CH		
	Drawing No.	CY-C0012-09	Rev.	C	Material	P. V. C	Unit	mm	
					HEFT(g)	180			



GB 1002
GB 2099

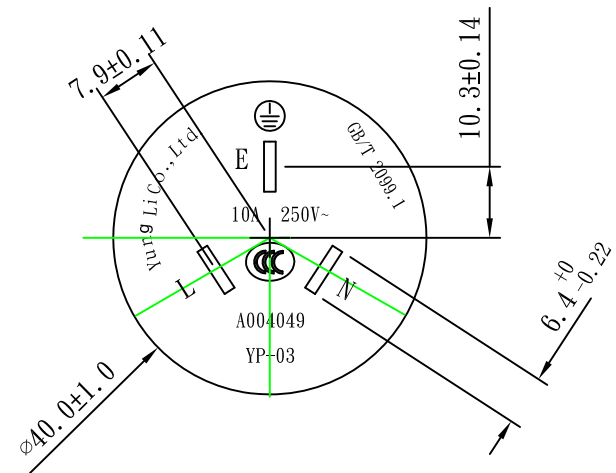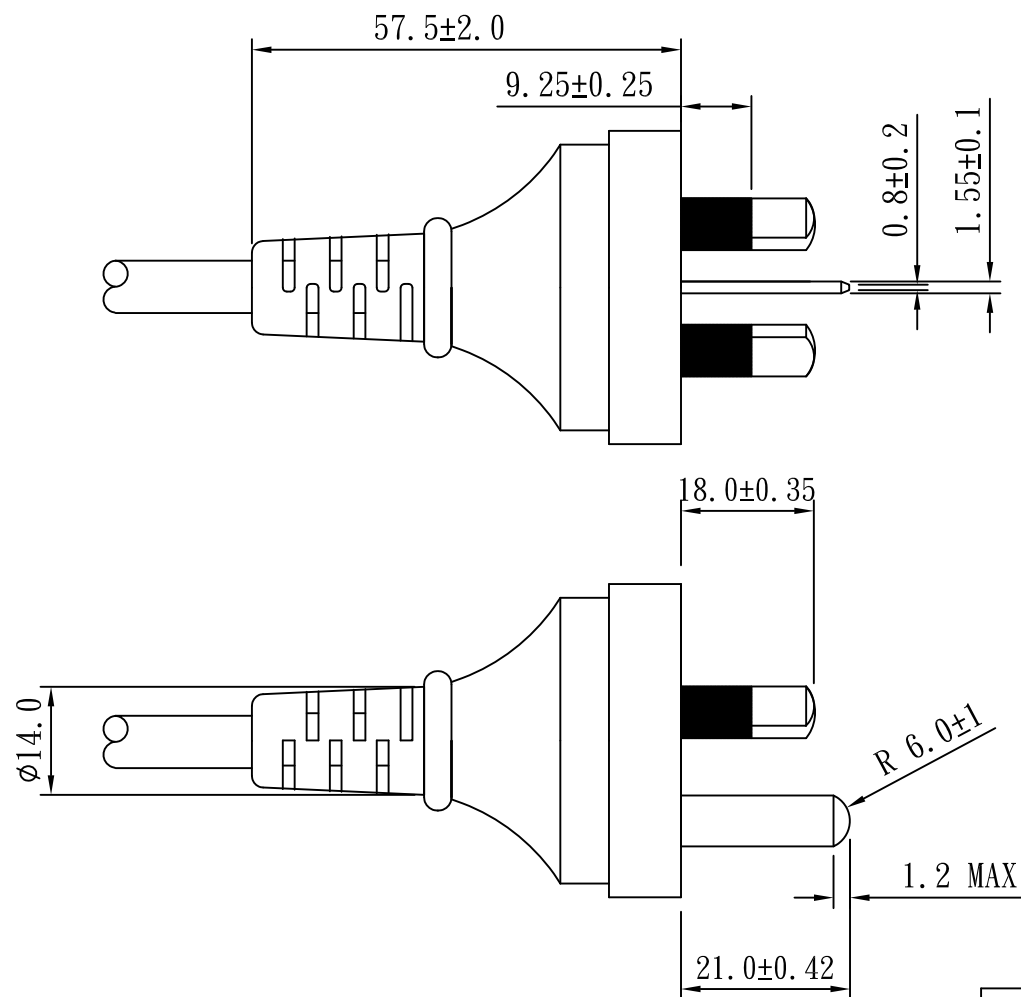

TOLERANCE >0±0.30 >1.0±0.50 >10.0±1.0 >20.0±2.0 Angle: ±1°	APPROVED		DATE		YUNG LI CO., LTD.			
	CHECKED		DATE					
	DRAWN	陳守瑞	DATE	25.04.17				
	TYPE	YP-03			P/N			
	DRAWING NO				MATERIAL	P. V. C	UNIT	mm
					SCALE	1:1		

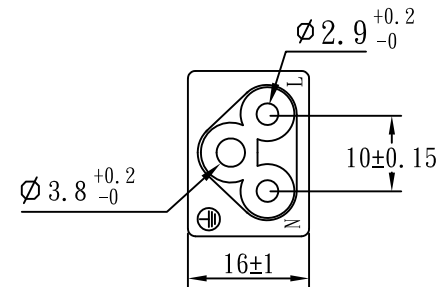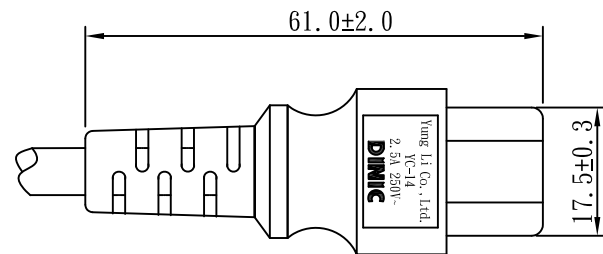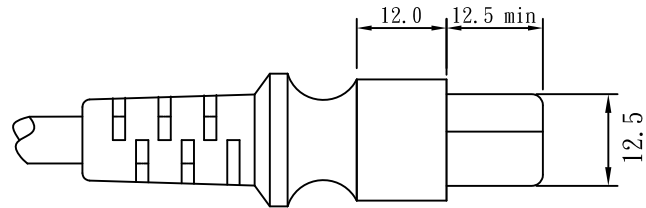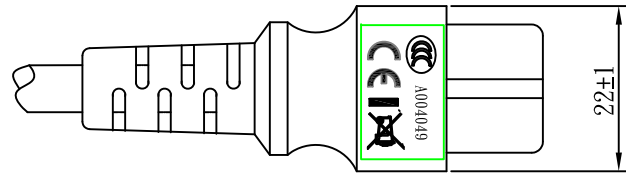

TOLERANCE >0±0.30 >1.0±0.50 >10.0±1.0 >20.0±2.0 Angle: ±1°	APPROVED		DATE		YUNG LI CO., LTD.			
	CHECKED		DATE					
	DRAWN		DATE					
	TYPE	YC-14 CCC			P/N			
					MATERIAL	P.V.C	UNIT	mm
	DRAWING NO				SCALE	1:1	 	

YUNG LI CO., LTD

SPECIFICATION

Yung Li	Style	PVC FLEXIBLE CORDS	Document No
2025.02.13			
Edition	Size	H05VV-F 3G 0.75mm²	Page
A			1/2

1. Standard: IEC 60227 IEC60228

2. Construction & Dimension

Item		Specification
Conductor	Size	3G 0.75mm ²
	Material	Annealed Bare Copper
	Construction	24/ ϕ 0.202 $\pm$ 0.008
Insulation	Material	PVC
	Minimum Average Thickness	0.60mm
	Minimum Thickness at any point	0.44mm
	Diameter	2.35 $\pm$ 0.10
	Identification	Blue,Brown,Green/Yellow
Core Assembly	Core Twist	3-Core
	Filler	NA
	Assembly Pair	NA
Taping	Mylar Foil	NA
Shielded	A1-Mylar Foil	NA
Drain	Material	NA
	Construction	NA
Jacket	Material	PVC
	Minimum Average Thickness	0.8mm
	Minimum Thickness at any point	0.58mm
	Overall Diameter(Approx)	6.7 $\pm$ 0.2
	Color	Any Color

Marking:

☒ Yung Li Co., Ltd. H05VV-F 3G 0.75mm² ◁VDE▷ Ⓒ SAA-190646-EA
Ⓜ SU01027-4002 Ⓜ A004049 60227 IEC 53(RVV) 300/500V

YUNG LI CO., LTD


SPECIFICATION

Yung Li	Style	PVC FLEXIBLE CORDS	Document No
2025.02.13			
Edition	Size	H05VV-F 3G 0.75mm ²	Page
A			2/2

3.Electrical & Physical Properties

Item		Specification	
Rating Voltage		70℃ 300/500V	
Conductor resistance(AT 20℃)		26.0Ω/Km MAX	
Insulation Resistance(AT 70℃)		0.011MΩ/Km Min	
Dielectric Strength		AC 2.0 KV / 15 min No Brcak	
Spark Test		6.0KV	
Insulation	Unaged	Tensile Strength	1.02 kgf/mm ² min
		Elongation	150% Min
	Aged	Tensile Strength	80~120% (80℃ x168hrs)
		Elongation	80~120% (80℃ x168hrs)
	Loss of mass Test		2.0mg/cm ² (max)
Jacket	Unaged	Tensile Strength	1.02 kgf/mm ² min
		Elongation	150% Min
	Aged	Tensile Strength	80~120% (80℃ x168hrs)
		Elongation	80~120% (80℃ x168hrs)
	Loss of mass Test		2.0mg/cm ² (max)
Deformation Test		70±2℃ X 4hr ≤ 50%	
Cold Bend Test		-15℃ x 1hr No Crack	
Heat Shock Test		150±2℃ x 1hr No Crack	

Graph:

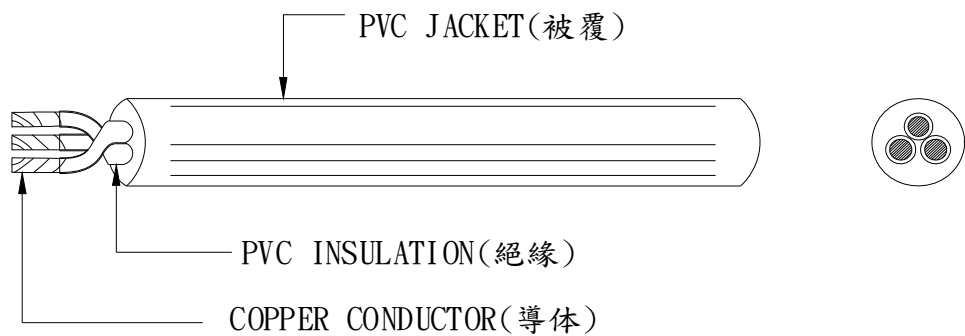



中国国家强制性产品认证证书

证书编号: 2007010101249048

认证委托人名称及地址

东莞永力电业有限公司
广东省东莞市常平镇大埔工业街 32 号

生产者名称及地址

东莞永力电业有限公司
广东省东莞市常平镇大埔工业街 32 号

生产企业名称及地址

东莞永力电业有限公司
广东省东莞市常平镇大埔工业街 32 号

产品名称和系列、型号、规格

电线组件

YP-03 10A 250V~+YC-14 2.5A 250V~(配 60227IEC53 3×0.75 平方毫米,60227IEC53 3×1 平方毫米),YP-03 10A 250V~+YC-14L 2.5A 250V~(配 60227IEC53 3×0.75 平方毫米,60227IEC53 3×1 平方毫米),YP-03L 10A 250V~+YC-14L 2.5A 250V~(配 60227IEC53 3×0.75 平方毫米,60227IEC53 3×1 平方毫米),YP-03L 10A 250V~+YC-14 2.5A 250V~(配 60227IEC53 3×0.75 平方毫米,60227IEC53 3×1 平方毫米)

产品标准和技术要求

GB/T 15934-2024

上述产品符合《强制性产品认证实施规则 电路开关及保护或连接用电器装置（电器附件）》（CNCA-C02-01:2014）的要求，特发此证。

发证日期: 2025 年 05 月 16 日 有效期至: 2028 年 08 月 31 日

本证书为变更证书，证书首次颁发日期: 2007 年 09 月 27 日
证书信息和有效性可扫描下方二维码或登录发证机构网站查验，
也可在认监委网站（www.cnca.gov.cn）查询。



签发:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司





CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2007010101249048

NAME AND ADDRESS OF THE APPLICANT

YUNG LI CO., LTD.

No. 32, Dapu Industrial St., Changping Town, Dongguan City, Guangdong Province, China

NAME AND ADDRESS OF THE MANUFACTURER

YUNG LI CO., LTD.

No. 32, Dapu Industrial St., Changping Town, Dongguan City, Guangdong Province, China

NAME AND LOCATION OF THE FACTORY

YUNG LI CO., LTD.

No. 32, Dapu Industrial St., Changping Town, Dongguan City, Guangdong Province, China

PRODUCT NAME, MODEL AND SPECIFICATION

Cord set

YP-03 10A 250V ~ +YC-14 2.5A 250V ~ (配 60227IEC53 3×0.75 平方毫米, 60227IEC53 3×1 平方毫米), YP-03 10A 250V ~ +YC-14L 2.5A 250V ~ (配 60227IEC53 3×0.75 平方毫米, 60227IEC53 3×1 平方毫米), YP-03L 10A 250V ~ +YC-14L 2.5A 250V ~ (配 60227IEC53 3×0.75 平方毫米, 60227IEC53 3×1 平方毫米), YP-03L 10A 250V ~ +YC-14 2.5A 250V ~ (配 60227IEC53 3×0.75 平方毫米, 60227IEC53 3×1 平方毫米)

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 15934-2024

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification (REFNO. CNCA-C02-01:2014).

Valid from: May.16,2025

Valid until: Aug.31,2028

Date of original issued: Sep.27,2007

The certificate information and validity could be checked by scanning the QR code below or logging in to the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.





中国国家强制性产品认证证书

证书编号: 2004010105138414

发证日期: 2023 年 08 月 29 日

有效期至: 2025 年 11 月 20 日

认证委托人名称 东莞永力电业有限公司
及注册地址 广东省东莞市常平镇大埔工业街 32 号

产品生产者名称 东莞永力电业有限公司
及注册地址 广东省东莞市常平镇大埔工业街 32 号

生产企业名称 东莞永力电业有限公司
及生产地址 广东省东莞市常平镇大埔工业街 32 号

产品名称和系列、规格、型号 聚氯乙烯绝缘电缆电线
60227 IEC 52(RVV) 300/300V 0.5-0.75(2-3 芯); 60227 IEC 53(RVV) 300/500V 0.75-2.5(2-5 芯);

产品标准和 GB/T 5023.5-2008/IEC60227-5:2003
技术要求

上述产品符合 CNCA-C01-01:2014 认证规则的要求, 特发此证。
证书有效期内本证书的有效性依据发证机构的定期监督获得保持。
本证书为变更证书, 证书首次颁发日期: 2005 年 01 月 04 日
经中国合格评定国家认可委员会认可 CNAS C001-P

可通过扫描下方二维码或登录国家认监委网站 (www.cnca.gov.cn) 查验证书信息



签发:

谢肇煦



中国质量认证中心





CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2004010105138414

Valid from: Aug.29,2023

Valid until: Nov.20,2025

NAME AND REGISTERED ADDRESS OF THE APPLICANT Yung Li Co.,Ltd.
No. 32, Dapu Industrial St.,Changping Town, Dongguan City,Guangdong Province,China

NAME AND REGISTERED ADDRESS OF THE MANUFACTURER Yung Li Co.,Ltd.
No. 32, Dapu Industrial St.,Changping Town, Dongguan City,Guangdong Province,China

NAME AND LOCATION OF THE FACTORY Yung Li Co.,Ltd.
No. 32, Dapu Industrial St.,Changping Town, Dongguan City,Guangdong Province,China

PRODUCT MODEL(S) PVC insulated flexible cables and wires
60227 IEC 52(RVV) 300/300V 0.5-0.75(2-3C); 60227 IEC 53(RVV) 300/500V 0.75-2.5(2-5C);

STANDARDS AND TECHNICAL REQUIREMENTS GB/T 5023.5-2008/IEC60227-5:2003

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO. CNCA-C01-01:2014)

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original issued: Jan.04,2005

Accredited by China National Accreditation Service for Conformity Assessment CNAS C001-P

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGNATURE:

谢肇煦



CHINA QUALITY CERTIFICATION CENTRE